



中国认可
国际互认
检测
TESTING
CNAS L0699



TEST REPORT


CEPRI-EETC08-2019-0327 (E)

Client: Shenzhen Woer Electric Technology Co., Ltd.

Object: 8.7/15kV screened separable connector

Type: WEB(K)III-15/630 3×185

Test Category: Type Tests

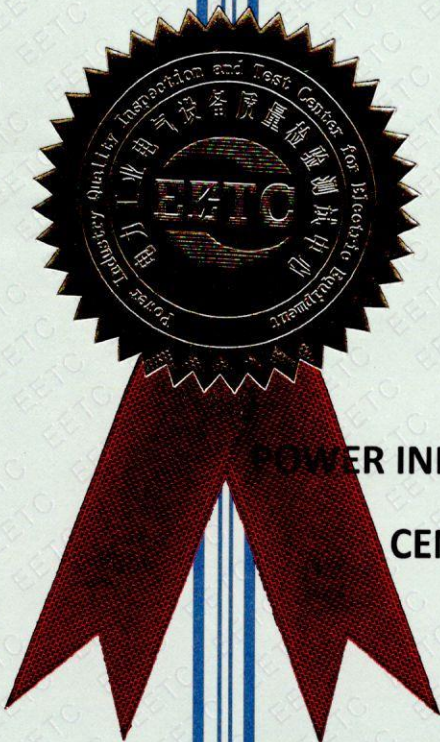

POWER INDUSTRY QUALITY INSPECTION AND TEST
CENTER FOR ELECTRIC EQUIPMENT

NOTICE

1. This report will enter into effect with seals of test center.
2. This report is legally made available accompany with compiled, checked, verified and approved signatures.
3. Alter the report is invalid.
4. This report only takes responsibility to the test object.
5. Part of copy is invalid.
6. Any objections in the report should be posed within 15 days once the report is received.
7. The inspection and testing management system of China Electric Power Research Institute includes the following institutes:

National Wind Power Integration Research and Test Center

☆ **Power Industry Quality Inspection and Test Center for Electric Equipment**

Power Industry Quality Inspection & Test Center for Electric Power Equipment and Instruments

Power Industry Quality Inspection & Test Center for Electrical Material and Components

Power Industry Quality Inspection & Test Center for Automation Equipment

Power Industry Quality Inspection & Test Center for Communication Equipment

Power Industry Quality Inspection & Test Center for Concrete Power and Communication Poles

Power System Electromagnetic Compatibility and Electromagnetic Environmental Research and Monitoring Center

Address: NO.143, Luoyu Road, Hongshan District, Wuhan, Hubei Province, 430074.

Fax: 86-27-5937-8488 Service line: 400-656-5689 Supervision hotline: 010-82813498

E-mail: eetc@epri.sgcc.com.cn

Website: <http://www.epri.sgcc.com.cn>

Catalogue

1. Catalogue.....	1
2. Signature Page	2
3. Test Results.....	3
4. Content.....	5
5. Appendix A Object Parameters.....	8
6. Appendix B The Main Test Devices	9
7. Appendix C Waveforms.....	10
8. Appendix D Other Information	14

Test Report	Power Industry Quality Inspection and Test Center for Electric Equipment		CEPRI-EETC08-2019-0327(E) Total 15 Page 2
Client	Shenzhen Woer Electric Technology Co., Ltd.	Manufacturer	Shenzhen Woer Electric Technology Co., Ltd.
Object	8.7/15kV screened separable connector	Type	WEB(K)III-15/630 3×185
Sampling procedure	by the Client	Serial No.	EETC08-19/06/01-001
Test Category	Type Tests	Date	2019.06.13~2019.09.19
Requirements	<p>1. GB/T 12706.4—2008 Power cables with extruded insulation and their accessories for rated voltages from 1 kV ($U_m=1.2$ kV) up to 35 kV ($U_m=40.5$ kV) — Part 4: Test requirements on accessories for cables with rated voltages from 6 kV ($U_m=7.2$ kV) up to 35 kV ($U_m=40.5$ kV)</p> <p>2. IEC 60502-4:2010 Power cables with extruded insulation and their accessories for rated voltages from 1 kV ($U_m=1.2$ kV) up to 30 kV ($U_m=36$ kV) - Part 4: Test requirements on accessories for cables with rated voltages from 6 kV ($U_m=7.2$ kV) up to 30 kV ($U_m=36$ kV)</p>		
Conclusion	<p>According to GB/T 12706.4—2008 and IEC 60502-4:2010, type tests were performed on 8.7/15kV screened separable connectors which were provided by Shenzhen Woer Electric Technology Co., Ltd. All the results were in accordance with the requirements.</p>		
Note	/		
<p>Tested by: 韩卫京  付平 </p>			
<p>Checked by: 彭超  Verified by: 苗付贵 </p>			
<p>Approved by: 邬雄  Date of issue: 2019-09-30</p>			

Test Results

No.	Item	Requirements	Results				Evaluation
1	Sequence 4.1	/	/				/
1.1	AC voltage test	No breakdown shall occur at 39 kV for 5 min	No breakdown occurred on the combination samples at 39 kV for 5 min				passed
1.2	DC voltage test	Neither breakdown nor flashover shall occur at 35 kV for 15 min	No breakdown and flashover occurred on the combination samples at 35 kV for 15 min				passed
1.3	Partial discharge test at ambient temperature	The magnitude of the discharge at 15 kV shall not exceed 10 pC	Phase	Y	G	R	passed
			Voltage (kV)	15	15	15	
			Noise background (pC)	1.0	1.0	1.0	
			Discharge (pC)	1.0	1.0	1.0	
1.4	Impulse voltage test at 95 °C ~ 100 °C	No breakdown shall occur at 10 positive and 10 negative impulses of 95 kV	No breakdown occurred on the combination samples at 10 positive and 10 negative impulses of 95kV (See Appendix C.1)				passed
1.5	Heating cycle voltage test	No breakdown shall occur during 30 cycles in air and 30 cycles under water at the conductor temperature of 95°C to 100°C and 22 kV	No breakdown occurred on the combination samples during 30 cycles in air and 30 cycles under water at the conductor temperature of 95°C to 100°C and 22 kV				passed
1.6	Partial discharge test at 95°C ~ 100°C	The magnitude of the discharge at 15 kV shall not exceed 10 pC	Phase	Y	G	R	passed
			Voltage (kV)	15	15	15	
			Noise background (pC)	1.3	1.3	1.3	
			Discharge (pC)	1.3	1.3	1.3	
1.7	Partial discharge test at ambient temperature	The magnitude of the discharge at 15 kV shall not exceed 10 pC	Phase	Y	G	R	passed
			Voltage (kV)	15	15	15	
			Noise background (pC)	1.3	1.3	1.3	
			Discharge (pC)	1.3	1.3	1.3	

No.	Item	Requirements	Results	Evaluation
1.8	Impulse voltage test	No breakdown shall occur at 10 positive and 10 negative impulses of 95 kV	No breakdown occurred on the combination samples at 10 positive and 10 negative impulses of 95 kV (See Appendix C.2)	passed
1.9	AC voltage test	No breakdown shall occur at 22 kV for 15 min	No breakdown occurred on the combination samples at 22 kV for 15 min	passed
1.10	Examination	It is advised that the accessory is examined for signs of any of the following: (i) cracking in the filling media and/or tape or tube components; (ii) a moisture path across a primary seal; (iii) corrosion and/or tracking and/or erosion; (iv) leakage of an insulating material.	(i) No cracking in the filling media and tape or tube components; (ii) No moisture path across a primary seal; (iii) No evident corrosion, tracking and erosion; (iv) No leakage of an insulating material.	passed
2	Sequence 4.2 and 4.3	/	/	/
2.1	AC voltage test	No breakdown shall occur at 39 kV for 5 min	No breakdown occurred on the combination samples at 39 kV for 5 min	passed
2.2	DC voltage test	Neither breakdown nor flashover shall occur at 35 kV for 15 min	No breakdown and flashover occurred on the combination samples at 35 kV for 15 min	passed
2.3	Thermal short-circuit test (screen)	No visible deterioration at 3.5 kA, 1 s, twice	No visible deterioration at 3.524 kA, 1.02 s and 3.504 kA, 1.02 s (See Appendix C.4)	passed
2.4	Thermal short-circuit test (conductor)	No visible deterioration at 22.6 kA, 2 s, twice	No visible deterioration at 23.89 kA, 2.02s and 23.76 kA, 2.02 s (See Appendix C.5)	passed
2.5	Dynamic short-circuit test	No visible deterioration at 80.1 kA, not less than 10 ms	No visible deterioration at 82.18 kA, 76 ms (See Appendix C.6)	passed

No.	Item	Requirements	Results	Evaluation				
2.6	Impulse voltage test	No breakdown shall occur at 10 positive and 10 negative impulses of 95 kV	No breakdown occurred on the combination samples at 10 positive and 10 negative impulses of 95 kV (See Appendix C.3)	passed				
2.7	AC voltage test	No breakdown shall occur at 22 kV for 15 min	No breakdown occurred on the combination samples at 22 kV for 15 min	passed				
2.8	Examination	It is advised that the accessory is examined for signs of any of the following: (i) cracking in the filling media and/or tape or tube components; (ii) a moisture path across a primary seal; (iii) corrosion and/or tracking and/or erosion; (iv) leakage of an insulating material.	(i) No cracking in the filling media and tape or tube components; (ii) No moisture path across a primary seal; (iii) No evident corrosion, tracking and erosion; (iv) No leakage of an insulating material.	passed				
3	Other items	/	/	/				
3.1	Screen resistance tests	Screen resistance before and after the heating period shall not exceed 5000 Ω	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 30%;">before ageing</td> <td style="text-align: center;">446.7 Ω</td> </tr> <tr> <td>after ageing</td> <td style="text-align: center;">346.2 Ω</td> </tr> </table>	before ageing	446.7 Ω	after ageing	346.2 Ω	passed
before ageing	446.7 Ω							
after ageing	346.2 Ω							
3.2	Screen leakage current	Screen leakage shall not exceed 0.5 mA at 17.5 kV	Screen leakage didn't exceed 0.5 mA at 17.5 kV	passed				

Content

1. Sequence 4.1 in Table 7 of GB/T 12706.4—2008

1.1 AC voltage test

1.1.1 Test method

The test shall be carried out in accordance with GB/T 18889—2002, clause 4. No breakdown shall occur at 39 kV for 5 min.

1.2 DC voltage test**1.2.1 Test method**

The test was carried out in accordance with GB/T 18889—2002, clause 5. Neither breakdown nor flashover shall occur at 35 kV for 15 min.

1.3 Partial discharge test at ambient temperature**1.3.1 Test method**

The test voltage shall be raised gradually to and held at 18 kV for 10 s and then slowly reduced to 15 kV. The test shall be carried out in accordance with GB/T 18889—2002, clause 7.

1.4 Impulse voltage test at 95 °C~100 °C**1.4.1 Test method**

The test shall be carried out in accordance with GB/T 18889—2002, clause 6. The conductor of the cable shall be heated and stabilized for at least 2 h at a temperature of 95 °C~100 °C. No breakdown shall occur at 10 positive and 10 negative impulses of 95 kV.

1.5 Heating cycle voltage test**1.5.1 Test method**

The test shall be carried out in accordance with GB/T 18889—2002, clause 9. Each heating cycle shall be of at least 8 h duration with at least 2 h at a steady temperature of 5 °C to 10 °C above the maximum cable conductor temperature in normal operation, followed by at least 3 h of natural cooling to within 10 °C of ambient temperature. No breakdown shall occur during 30 cycles in air and 30 cycles under water at the conductor temperature of 95°C to 100°C and 22 kV.

1.6 Partial discharge test at 95 °C~100 °C**1.6.1 Test method**

The test voltage shall be raised gradually to and held at 18 kV for 10 s and then slowly reduced to 15 kV. The test shall be carried out in accordance with GB/T 18889—2002, clause 7. The conductor temperature shall be of 95°C to 100°C during the test.

1.7 Partial discharge test at ambient temperature**1.7.1 Test method**

The test voltage shall be raised gradually to and held at 18 kV for 10 s and then slowly reduced to 15 kV. The test shall be carried out in accordance with GB/T 18889—2002, clause 7.

1.8 Impulse voltage test**1.8.1 Test method**

The test shall be carried out in accordance with GB/T 18889—2002, clause 6. No breakdown shall occur at 10 positive and 10 negative impulses of 95 kV.

1.9 AC voltage test**1.9.1 Test method**

The test shall be carried out in accordance with GB/T 18889—2002, clause 4. No breakdown shall occur at 22 kV for 15 min.

1.10 Examination**1.10.1 Test method**

It is advised that the accessory is examined for signs of any of the following:(i) cracking in the filling media and/or tape or tube components;(ii) a moisture path across a primary seal;(iii) corrosion and/or tracking and/or erosion;(iv) leakage of an insulating material.

2. Sequence 4.2 and 4.3 in Table 7 of GB/T 12706.4—2008**2.1 AC voltage test****2.1.1 Test method**

The test shall be carried out in accordance with GB/T 18889—2002, clause 4. No breakdown shall occur at 39 kV for 5 min.

2.2 DC voltage test**2.2.1 Test method**

The test was carried out in accordance with GB/T 18889—2002, clause 5. Neither breakdown nor flashover shall occur at 35 kV for 15 min.

2.3 Thermal short-circuit test (screen)**2.3.1 Test method**

The test shall be carried out in accordance with GB/T 18889—2002, clause 10. At the beginning of the test, the cable conductor shall be heated to reach a steady temperature of 5 °C to 10 °C above the maximum cable conductor temperature in normal operation and shall last for at least 2 h. Then two short-circuits shall be applied to the screen. The short-circuit current and duration time shall be specified as the agreement between manufacturer and user according to the actual short-circuit condition of the power grid. Between the two short-circuits, the test loop shall be allowed to cool to a temperature less than 10 °C above its temperature prior to the first short-circuit. There shall be no visible deterioration on the samples.

2.4 Thermal short-circuit test (conductor)**2.4.1 Test method**

The test shall be carried out in accordance with GB/T 18889—2002, clause 11. Two short-circuits shall be applied using AC to raise the conductor temperature to the maximum permissible short-circuit temperature (250 °C) of the cable within 5 s. Between the two short-circuits, the test loop shall be allowed to cool to a temperature less than 10 °C above its temperature prior to the first short-circuit. There shall be no visible deterioration on the samples.

2.5 Dynamic short-circuit test**2.5.1 Test method**

The test shall be carried out in accordance with GB/T 18889—2002, clause 12. The dynamic short-circuit current value shall be 2.5 times of the thermal short-circuit value when the thermal short-circuit time equals 1s. There shall be no visible deterioration on the samples after the short-circuit lasts for at least 10ms.

2.6 Impulse voltage test**2.6.1 Test method**

The test shall be carried out in accordance with GB/T 18889—2002, clause 6. No breakdown shall occur at 10 positive and 10 negative impulses of 95 kV.

2.7 AC voltage test**2.7.1 Test method**

The test shall be carried out in accordance with GB/T 18889—2002, clause 4. No breakdown shall occur at 22 kV for 15 min.

2.8 Examination**2.8.1 Test method**

It is advised that the accessory is examined for signs of any of the following:(i) cracking in the filling media and/or tape or tube components;(ii) a moisture path across a primary seal;(iii) corrosion and/or

tracking and/or erosion;(iv) leakage of an insulating material.

3. Other items in Table 7 of GB/T 12706.4—2008

3.1 Screen resistance tests

3.1.1 Test method

The test shall be carried out in accordance with GB/T 18889—2002, clause 14. Screen resistance before and after the heating period shall be measured at ambient temperature. According to clause 8.1 in GB/T 2951.2, the sample shall be placed in the air oven at the temperature of $(120 \pm 2)^\circ\text{C}$ for 168 h during the heating period.

3.2 Screen leakage current

3.2.1 Test method

The test shall be carried out in accordance with GB/T 18889—2002, clause 15. A metal foil of 25 cm^2 (namely $5\text{ cm} \times 5\text{ cm}$) shall be fixed to the outer shield of the separable connector as far as possible from the ground point (There shall be no air gap between the metal foil and the outer shield). The metal foil shall be grounded through a resistance of $2000\ \Omega$, and an AC voltage of 24kV shall be applied between the cable conductor of the combination samples and the ground to measure the leakage current.

Appendix A Object Parameters


A.1 Sample information

The sample was received by Power Cable Station on 01/06/2019. The sample was in good condition with the date of manufacture not provided.

A.2 The number and installation of samples

According to GB/T 12706.4—2008, It was required that two sets of samples to be tested were installed by the manufacturer on two length of cables forming combination samples on which the type tests sequence 4.1, 4.2 and 4.3 were carried out. Two sets of outdoor terminations were also installed by the manufacturer on the combination samples. The cable used in the combination samples was a XLPE insulated three-core cable for rated voltage 8.7/15 kV, a cross-section of 185 sq.mm. The length of the cable in the combination sample was greater than 5 m between terminations and the samples. Other type tests listed in table 7 were carried out on other samples.

A.3 Photograph of samples

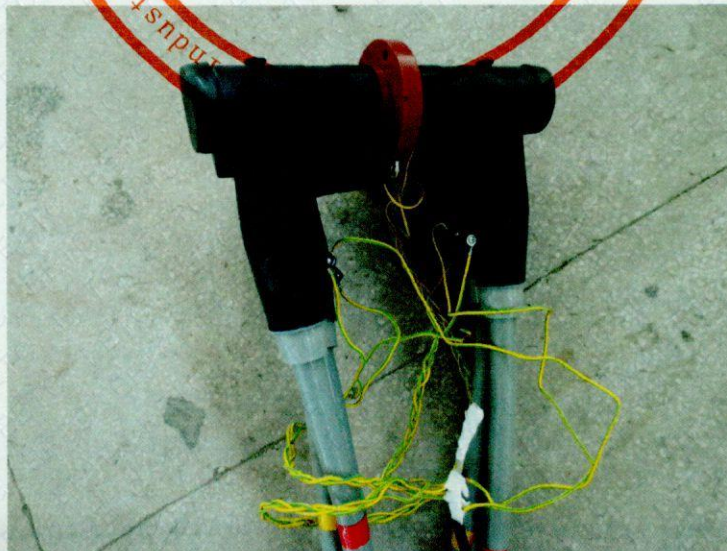

A.4 Photograph of dissected samples



Appendix B The Main Test Devices

No.	Name/ Type/ Specification	Serial No.	Measurement Range	Uncertainty / Accuracy class / Maximum Permissible Error	Calibration Institute	Valid Date
1	YD(W)-JZ-15/150 AC/DC Test Device	084326	(0~150)kV	Grade 3	National high voltage measurement station	2020.07.18
2	CQSB(J)-120/60 60 kV Power frequency test device	R12366	(0~60) kV	Class 3	National high voltage measurement station	2020.07.17
3	JFD-2H PD measurement system	20041202	(0.5~1000) pC	Class 10	National high voltage measurement station	2020.03.25
4	FY I 900/600 Weakly damped capacitive voltage divider	11165-2-1	(0~900) kV	Class 3	National high voltage measurement station	2020.06.29
5	H-DJF-2 Data collected system	CJ06	(0~100) kA	Class 0.5	National high voltage measurement station	2020.01.03
6	LCC-V Heating cycle monitoring system	DLRXH01	(0~3000) A	Class 3	National high voltage measurement station	2020.10.26
7	287C Digital voltage meter	31470016	(0~700) V	Class 1	Vkan Certification & Testing Co., Ltd. Measuring Center	2019.06.27

Appendix C Waveforms

C.1 The values and waveforms of impulse voltage on the combination samples before heating cycles voltage test

C.1.1 The values of impulse voltage test


Ambient temperature: 25.0°C

Relative humidity: 72%

Atmosphere: 0.1004MPa


Positive polarity (kV)	95.0	95.1	94.7	95.4	97.0	94.9	95.3	95.9	95.5	95.7
Negative polarity (kV)	96.5	95.8	97.1	97.1	94.9	95.4	95.1	95.7	94.6	96.1

C.1.2 The waveforms of impulse voltage test

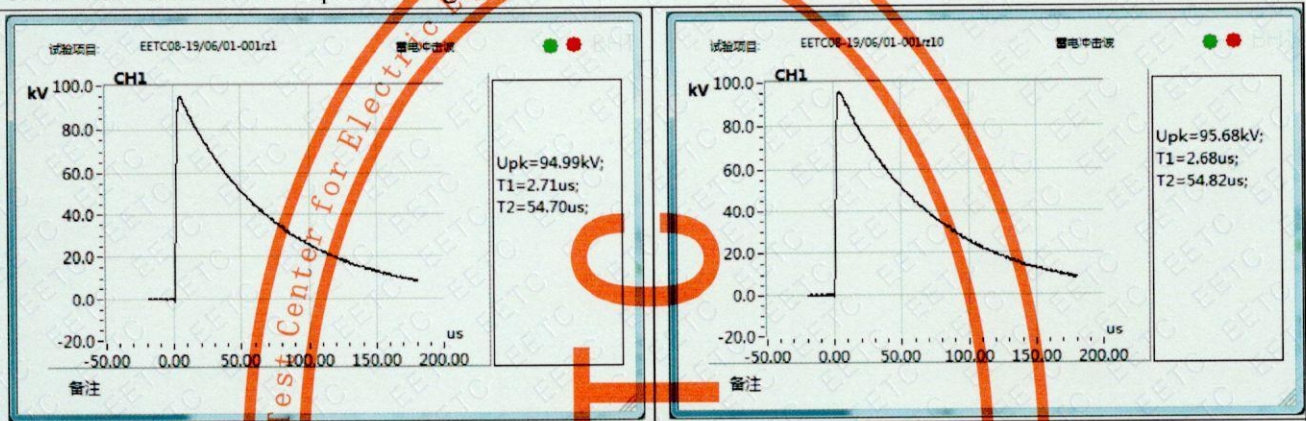

The 1st positive impulses waveform

The 10th positive impulses waveform

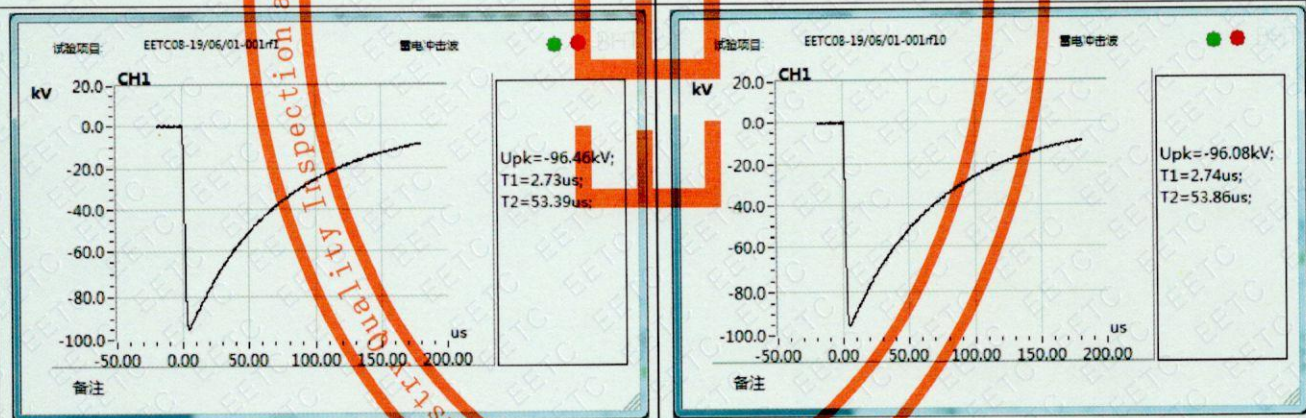

The 1st negative impulses waveform

The 10th negative impulses waveform

C.2 The values and waveforms of impulse voltage on the combination samples after heating cycles voltage test

C.2.1 The values of impulse voltage test


Ambient temperature: 31.0°C

Relative humidity: 62%


Atmosphere: 0.1000MPa

Positive polarity (kV)	97.5	96.4	96.3	95.7	97.2	96.7	96.7	96.5	96.7	97.9
Negative polarity (kV)	95.6	98.2	96.0	96.7	96.8	96.0	96.0	95.5	95.7	96.3


C.2.2 The waveforms of impulse voltage test

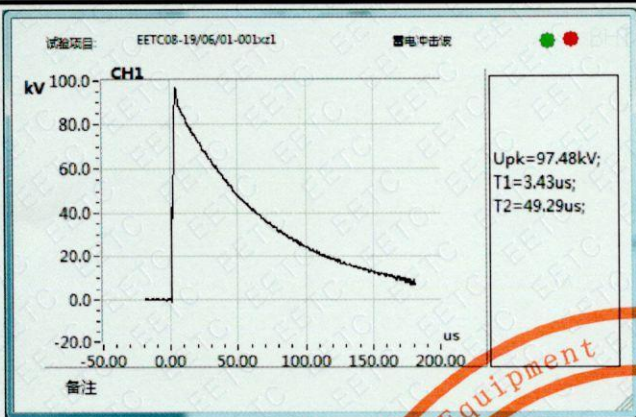


The 1st positive impulses waveform

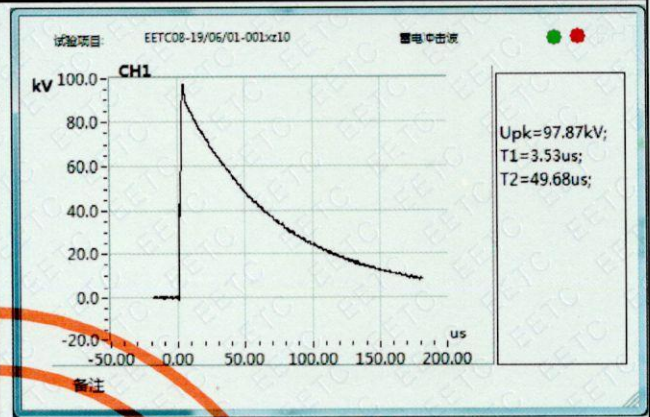

The 10th positive impulses waveform

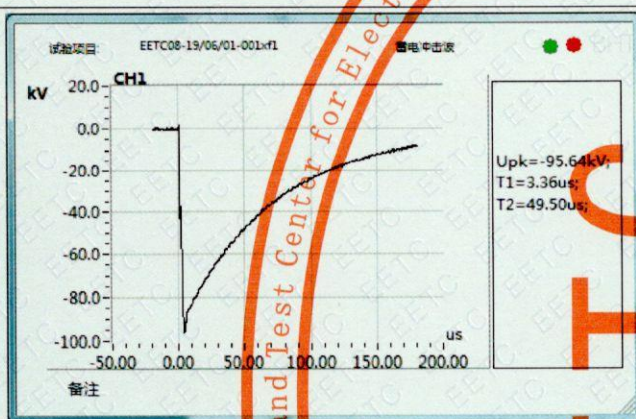

The 1st negative impulses waveform

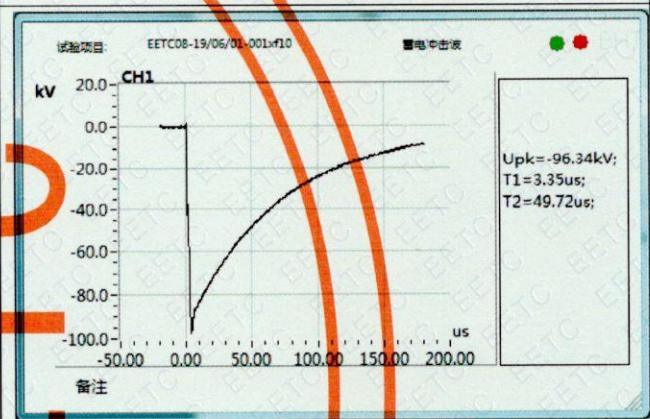

The 10th negative impulses waveform

C.3 The values and waveforms of impulse voltage on the combination samples after thermal and dynamic short-circuit tests

C.3.1 The values of impulse voltage test


Ambient temperature: 33.0°C

Relative humidity: 52%


Atmosphere: 0.1003MPa

Positive polarity (kV)	96.5	96.0	96.6	96.3	95.8	96.5	96.4	96.3	96.7	96.7
Negative polarity (kV)	94.3	96.3	95.6	96.2	95.5	96.2	95.7	96.2	95.6	94.9


C.3.2 The waveforms of impulse voltage test

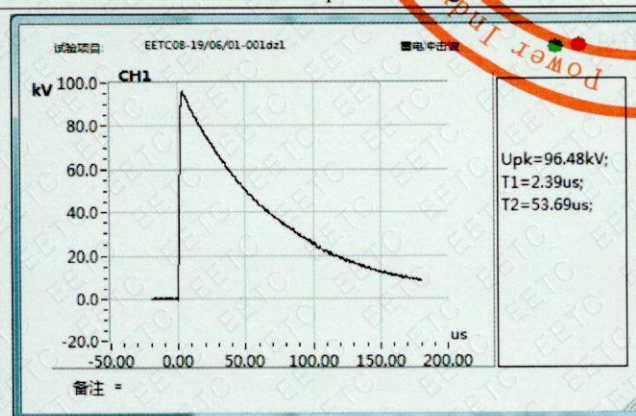


The 1st positive impulses waveform

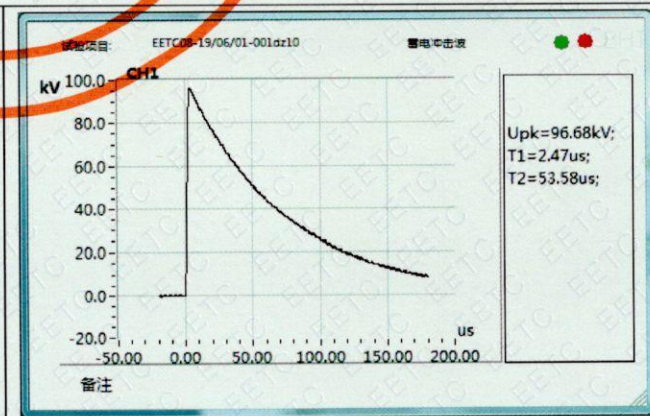

The 10th positive impulses waveform

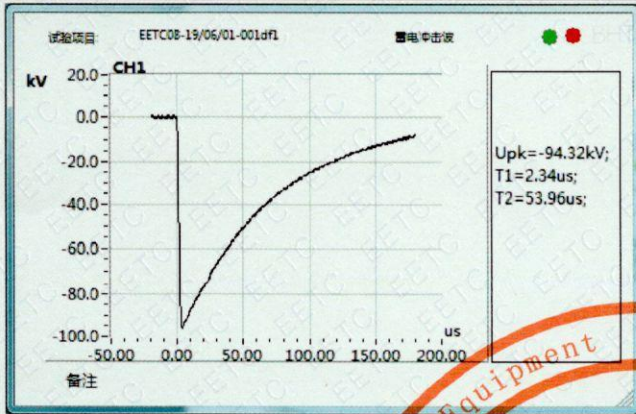


The 1st negative impulses waveform

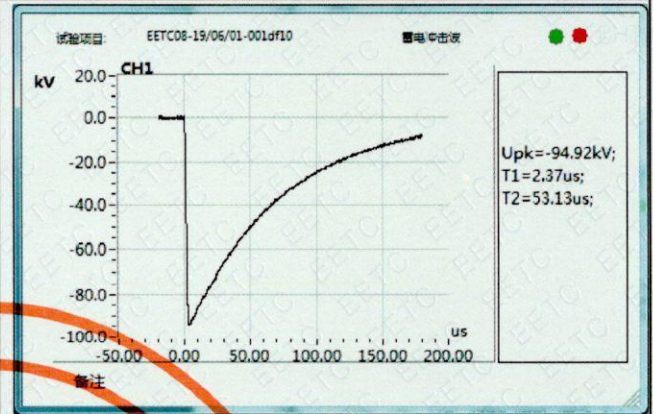


The 10th negative impulses waveform

C.4 The waveform of thermal short-circuit tests of the combination samples (screen)

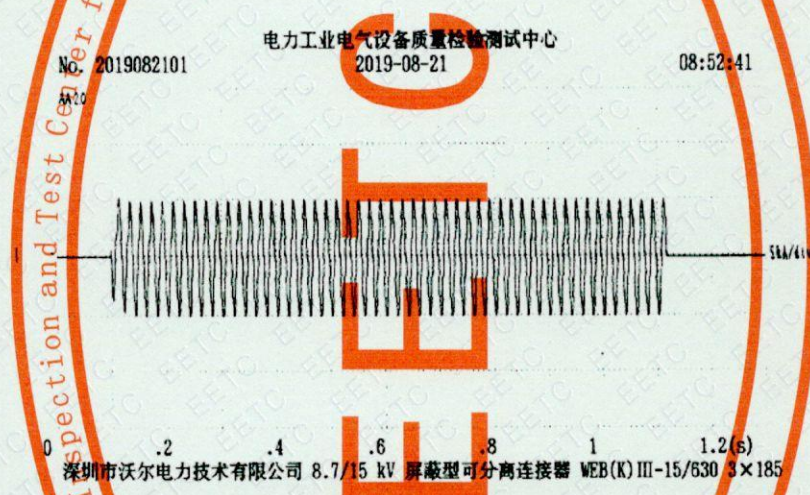

C.5 The waveform of thermal short-circuit tests of the combination samples (conductor)

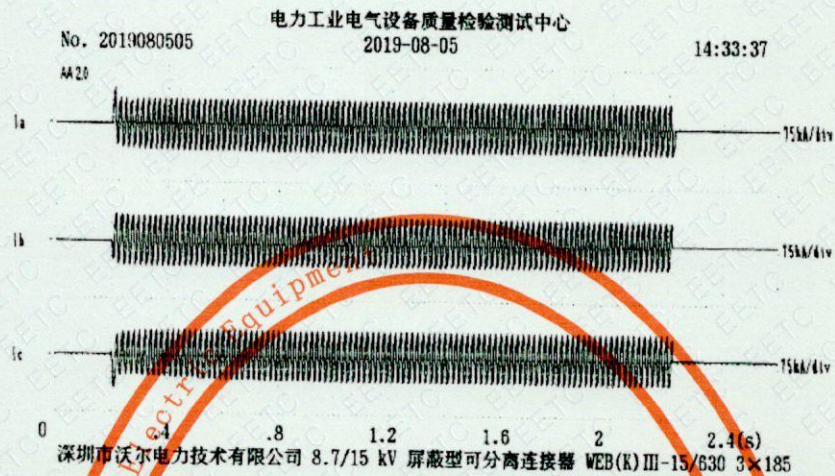

C.6 The waveform of dynamic short-circuit tests of the combination samples (conductor)



Appendix D Other Information

D.1 Sample packing list


8. 7/15kV 630A欧式可分离连接器装箱清单

序号	名称	单位	数量	备注
1	插拔头外套	个	3	前/后插头
2	应力控制体	个	3	
3	后封帽	个	3	后接头无
4	黄绿地线	条	3	非屏蔽插头无
5	半导体自粘带	盒	1	
6	清洁纸	包	9	
7	硅脂膏	管	2	
8	PE 手套	双	2	涂抹硅脂膏专用
9	砂条	条	1	
10	绝缘子堵盖	个	3	后插头无
11	六角套筒	个	1	后插头无
12	变径螺栓	套	3	
13	连接杆	个	3	前插头无
14	插头专用端子	个	3	
15	安装说明书	份	1	
16	装箱清单	份	1	
17	合格证	张	1	

D.2 Identification of test cable (specified in GB/T 12706.2—2008)

rated voltage $U_0/U(U_m)$		8.7/15(17.5) kV
construction	core	three-core
	construction of screen	separated screen
conductor	material	copper
	type	round compact stranded
	cross section	185 mm ²
	diameter	16.0 mm
insulation	material	XLPE
	thickness	4.6 mm
	diameter	27.1 mm
screen	thickness of conductor screen	0.8 mm
	thickness of insulation screen	0.8 mm
	strippability of insulation screen	strippable
	diameter of insulation screen	28.7 mm
	metallic screen	copper tape
armour		/
oversheath	material	PVC
	diameter	68.5 mm
mark of cable		YJV-8.7/15 3×185

D.3 Main structure dimensions of the samples

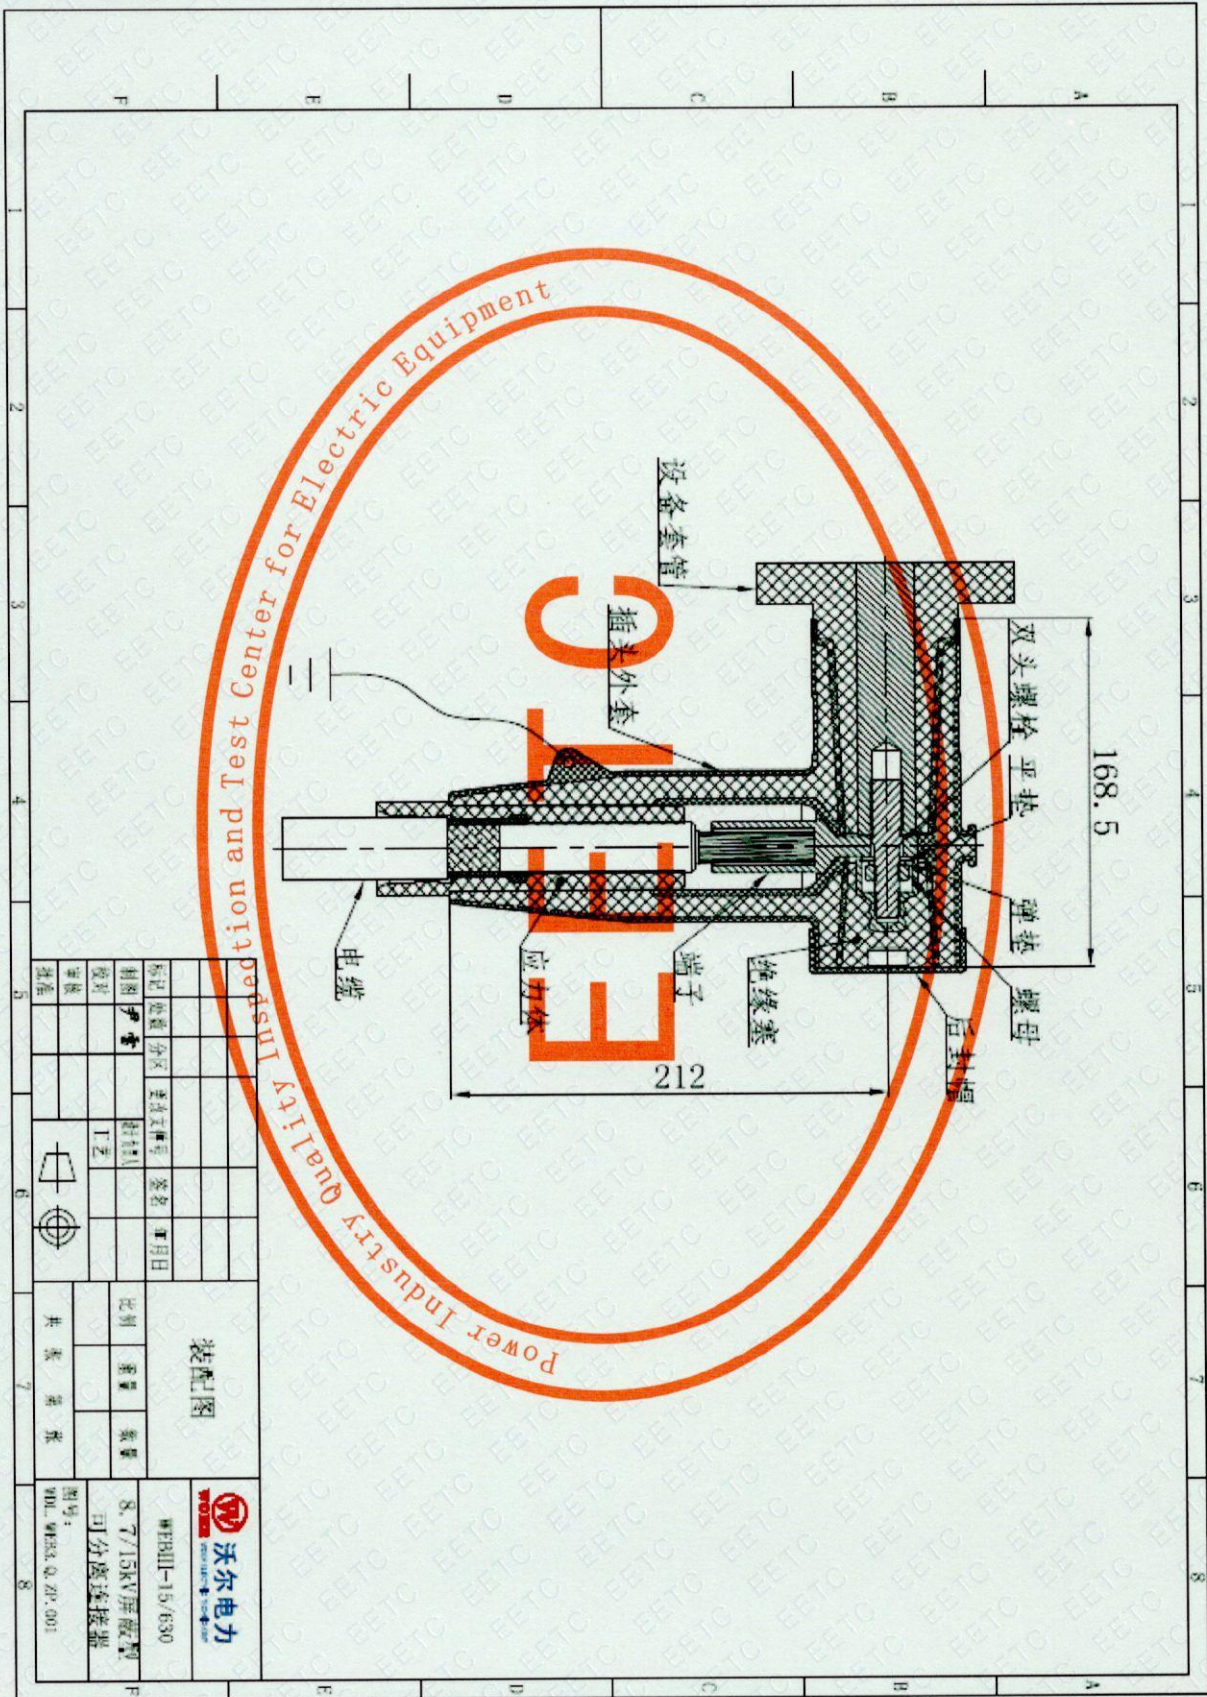

装配图		比例		重量		数量	
MFB11-15/630		8.7/15kV屏蔽型		可分离连接器		图号: 901.9833.0.2P.001	
标记	变更	分区	变更	日期	日期		
相数	电压	绝缘	材料	工艺	日期		
规格	型号	名称	日期	日期			
审核	日期	共		张			

Power Industry Quality Inspection and Test Center for Electric Equipment

